

CASED COIL SECTIONS SIZE:


Customer _____ E-MAIL ADDRESS: _____
 Job _____

PLEASE FILL OUT AS MUCH AS POSSIBLE E-MAIL TO: coils@discountcoil.com FAX TO 866-740-0934

DX COIL	CHILLED WATER COIL	CONDITIONS
REFRIGERANT	EWT	CFM
SUCTION TEMP	LWT	ENT AIR TEMP DB/WB
TONS	GLYCOL %	LVG AIR TEMP DB/WB

CASING MATERIAL:	STAINLESS STEEL
	GALVANIZED STEEL
	INDOOR
	OUTDOOR
	FILTER RACK

STANDARD MATERIALS OF CONSTRUCTION	
Drain Pan	GALV. STAINLESS
Drain	GALV. STAINLESS
Insulation	0.75" x 1.50" Density
Base	0.138" Galvanized Steel
Lifting Lugs	0.25" x 1.50" x 2.00" Angle Iron

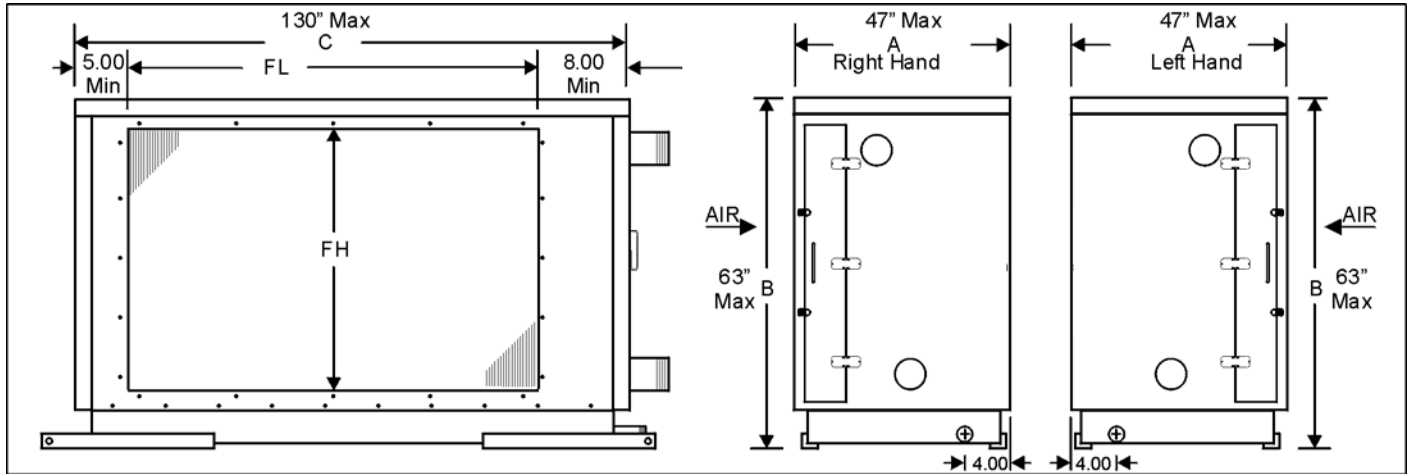

#	DIMENSIONAL DATA				
	Base 3" or 5"	Drain	A	B	C
1					
2		See Note 4		See Note 5	
3					
4					

NOTES :

GENERAL NOTES

1. Connection locations dependent on coil.
2. Coil mounted flush with side of cabinet using 0.25"-20 self-tapping screws.
3. Coils mounted to entering air side of cabinet.
4. If Base = 3" - Drain = 1", If Base = 5" - Drain = 1.25"
5. If Base = 3" - B = FH + 9". If Base = 5" - B = FH + 11".
6. Add 6 inches to A dim for filter rack door (std 2" filter rack)
7. If Base = 3" and Dim B is less than 27" or Base = 5: and Dim B is less than 29" - no access panel supplied.
8. Drain pan dual sloped toward drain.